



Addendum No. 3 page I

Project: 2018 Renovations & Improvements

Jeffersonville Township Public Library

Clarksville Facility

Clarksville, Indiana

Project No.: 1723.02

Date: February 9, 2018

This addendum is a part of the bid documents. Acknowledge receipt on the Proposal Form.

Specifications

1. Section 06650 - Plastic Fabrications

Paragraph 2.01, Item A, Add "Lumicor" as an approved equal.

Paragraph 2.02, Item A.7. Revise to read as follows: Colors: Architect to select from "Price Group B".

2. Section 07539 - Thermoplastic Olefin Sheet Roofing System (TPO)

Paragraph 1.07, Item B add the following:

D. Riney Roofing
2203 Stannye Drive, Louisville, Kentucky 40222
(502) 544-6202; (502) 882-3926 fax

3. <u>Section 08740 - Automatic Door Operators</u>

Paragraph 2.01, Add "Tucker Auto-matic" Swinging Door operators as an approved equal.

4. Section 10650 - Operable Partitions

Paragraph 2.01, Item A. add the following:

- 3. "Moderco Inc"
- 4. "Hufcor"
- 5. Section 12502 Window Shades

Paragraph 2.01, Item A. Add the following:

4. "Lafayette Interior Fashions"

Drawings

I. S-203 - Framing Details

Detail 4/S-203: Replace section detail indication "I/S-205" with "6/S-204".

Replace section detail indication "2/S-205" with "7/S-204".

Detail 5/S-203: Replace section detail indication "I/S-205" with "6/S-204".

Detail 8/S-203: Replace section detail indication "I/S-205" with "6/S-204".

Replace section detail indication "2/S-205" with "7/S-204".

2. I-101 - Finish Schedule

Flooring Type "C2": Add Pattern/ Color 7- Bevel Hexagon 5T057/ Tweed 55530





3. I-302 - Resin Panel System

Revise Plan 6/I-302 per attached Drawing AD-3b. Revised Elevation 7/I-302 per attached Drawing AD-3c.

4. E-001 - Electrical Demolition Keynotes

Replace Keynote D27 with the following:

Disconnect and remove power supplies for existing security gates. Remove existing circuit(s) back to source. See Drawing E-201 for information regarding power for new security gates.

5. E-201 - Electrical Power Plan Keynotes

Add Keynote E19 as follows:

Provide new dedicated 20A, 120V circuit from existing breaker made available during demolition to each set of new security gates. Circuit to be routed overhead and down concealed in existing construction to new conduit installed below floor slab. Contractor to saw cut existing terrazzo and concrete slab as required to install new conduits per attached Drawing AD-3a. Refer to finish plans for terrazzo patching. Low voltage CAT cable to security gates to be installed by Owner's separate data vendor. Security gate installation and associated low voltage cabling between pedestals is by Owner's separate vendor.

6. E-201 - Electrical Power Plan

Add Keynote E19 on the plan adjacent to the underfloor conduit running east-west just south of Vestibule 101.

7. E-201 - Electrical Power Plan

Add Keynote E19 on the plan adjacent to the underfloor conduit running east-west just north of Vestibule 118.

8. E-201 - Electrical Power Plan Add Detail 2 per attached Drawing AD-3a.

Prepared by,

Hal E. Kovert, AIA

Principal

enclosed: Drawing AD-3a, AD-3b, AD-3c

file: 1723.02/E-1


END OF ADDENDUM NO. 3 (5 total pages)

architects

630 Walnut Street Jeffersonville, IN 47130 812. 282. 9554 812. 282. 9171 FAX www.koverthawkins.com

ALL CONDUITS TO BE CUT FLUSH WITH TOP OF SLAB. NOTE

COORDINATE EXACT ROUGH-IN DIMENSIONS AND IDENTIFY SLAVE PEDESTAL FOR 120V CIRCUIT TERMINATION WITH OWNER'S SEPARATE VENDOR.

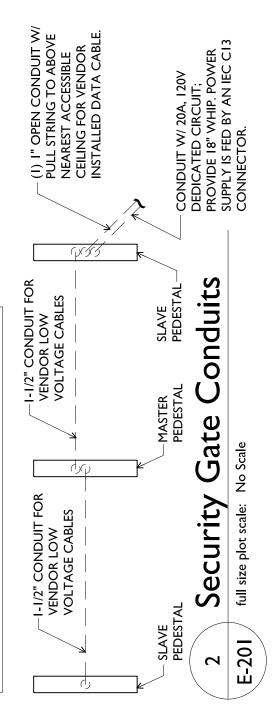




Revisions Clarksville, Indiana 47129 Clarksville Branch Library Jeffersonville Township Public Library

2018 Renovation & Addition


Certified By

AD-3a

1312 Eastern Boulevard

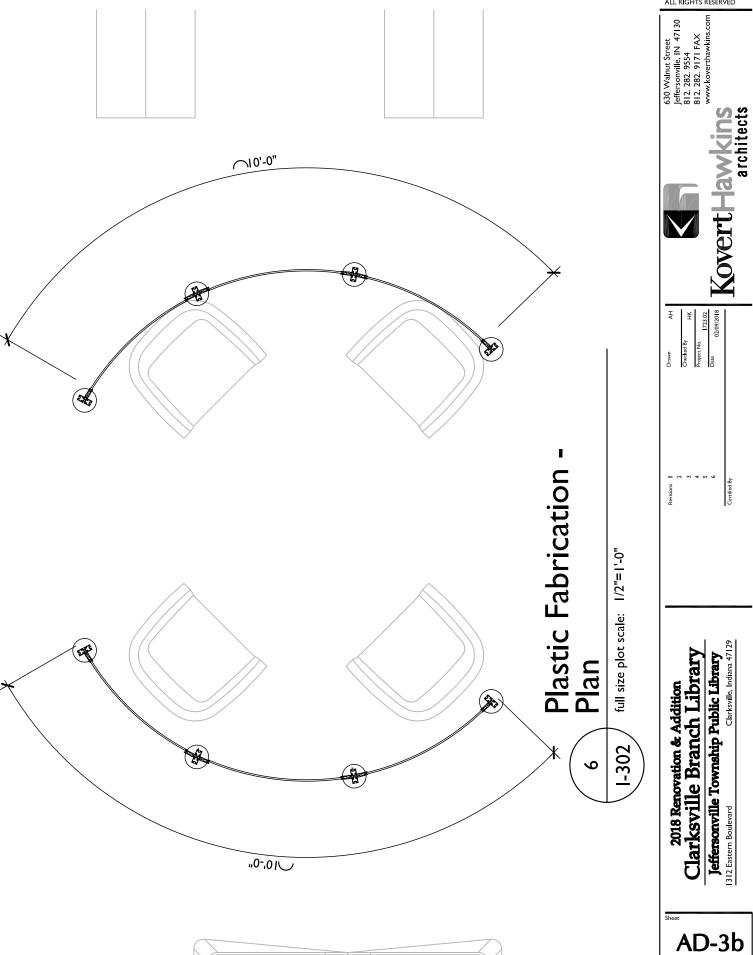

architects

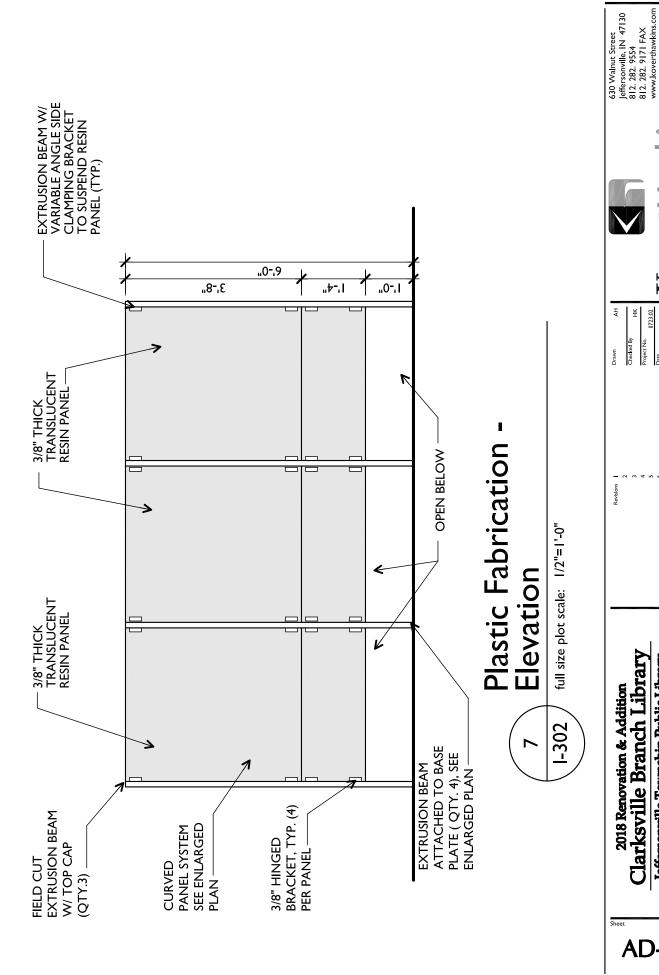

Project No. 1723.02 02/06/2018 ¥ Checked By

Certified By

Clarksville Branch Library Jeffersonville Township Public Library 2018 Renovation & Addition

Clarksville, Indiana 47129

1312 Eastern Boulevard

AD-3c